COLUMN SCHEDULE

MARK	COLUMN SECTION	BASE PLATE BxNxT DETAIL	ANCHOR RODS OR FASTENERS
C1	(2) 2x6 JACK STUDS PLUS (2) 2x6 KING STUDS	SIMPSON A35 5 / S5001	(1) 5/8"Ø x 6" EMBED. ANCHOR ROD
C2	HSS7x5x3/8	16x16"x1 1/4" 6 / S5001	(6) 7/8"Ø F1554 GR36 WITH 12" EMBEDMENT
C3	5 1/4x5 1/4 PSL WOOD	SIMPSON RPBZ 8 / S5001	(2) 1/4"Ø x 1 3/4" LG. SIMPSON TITEN SCREWS
C4	6x6 #2 SOUTHERN PINE	SIMPSON A35 5 / S5001	(1) 5/8"Ø x 6" EMBED. ANCHOR ROD

FOOTING SCHEDULE

MARK	DIMENSIONS (WIDTHxLENGTHxTHICKNESS)	REINFORCING
WF2.0	2'-0"xCONTx1'-4"	(3) #5 BOT (CONT.)
WF4.0	4'-0"xCONTx1'-4"	(5) #5 TOP & BOTTOM AND #5 @ 24" O.C. TRANSVERSE TOP & BOT.
F3.0	3'-0"x3'-0"x1'-4"	(3) #5 E.W. BOT

GENERAL NOTES

- FOR STRUCTURAL GENERAL NOTES AND DESIGN CRITERIA, REFER TO SHEET S0001 .
- DIMESIONS: VERIFY ALL DIMENSIONS AND ELEVATIONS WITH THE ARCHITECTURAL DRAWINGS. ALL DIMENSIONS SHOWN ARE TO OUTSIDE FACE OF STUD, OR CENTERLINE OF STEEL COLUMN. CONTINUOUS FOOTINGS ARE CENTERED UNDER PERIMETER WALL STUDS.
- TOP OF SLAB ELEVATION 0'-0".
- REFER TO SHEET S0001 FOR SUBGRADE PREPARATION AND FILL REQUIREMENTS AT SLABS AND FOOTINGS.
- "WF-X" INDICATES WALL FOOTING. SEE SCHEDULE ON THIS SHEET.
- "F-X" INDICATES COLUMN FOOTING. SEE SCHEDULE ON THIS SHEET.
- ALL WOOD IN CONTACT WITH WEATHER-EXPOSED CONCRETE OR WITHIN 8" OF FINISHED GRADE SHALL BE PRESSURE-TREATED.
- "SW-X" INDICATES SHEAR WALL. FOR SHEAR WALL ELEVATION, DETAILS, AND SCHEDULE, SEE SHEET S5001.
- "HDU-X" INDICATES HOLDOWN PER SCHEDULE ON SHEET S5001.
- "C-X" INDICATES STEEL OR WOOD COLUMN. SEE SCHEDULE ON THIS SHEET.

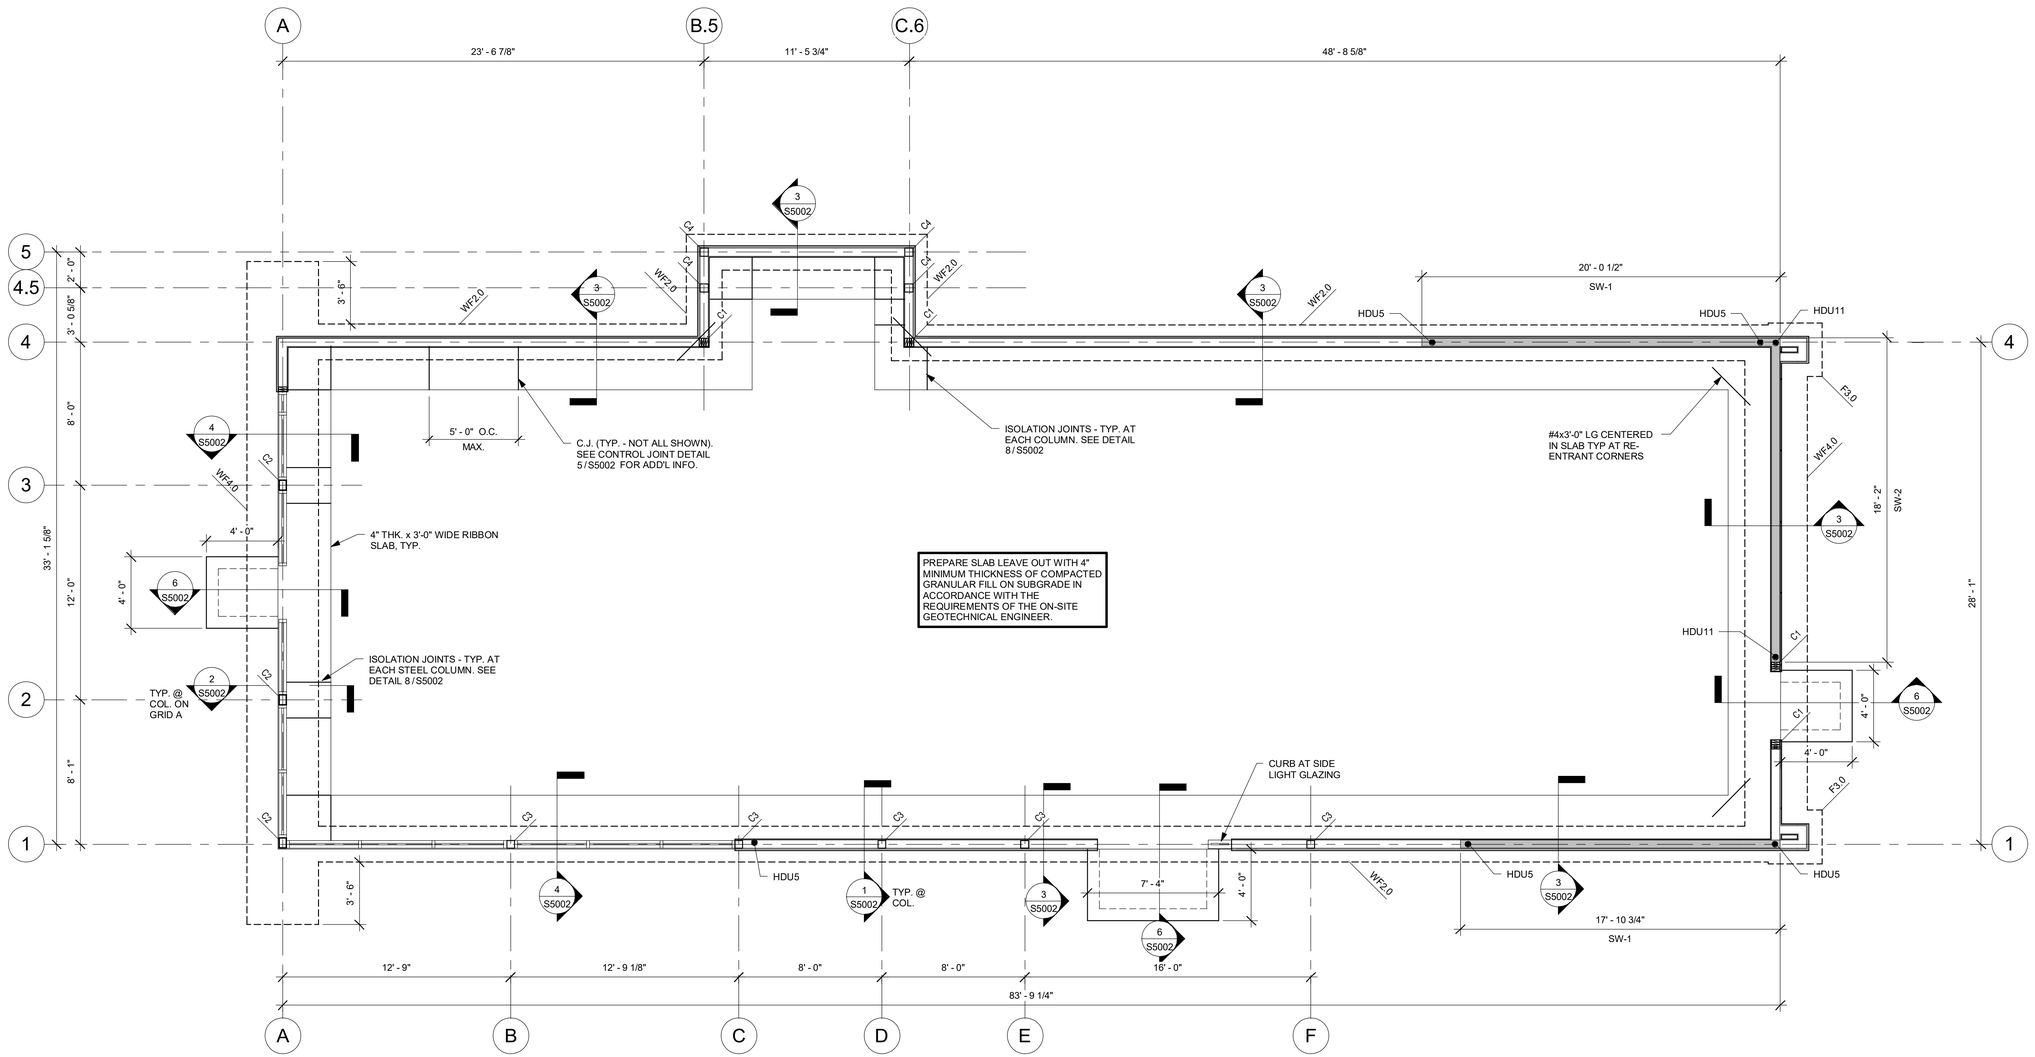

1 FOUNDATION PLAN
Scale: 1/4" = 1'-0"

GPD Engineering and Architecture
Professional Corporation - C3879
520 S. MAIN ST., SUITE 2531
AKRON, OH 44311
PHONE: 330.572.2100
FAX: 330.572.2101

Copyright GPD Engineering and Architecture Professional Corporation 2020

REV.	DESCRIPTION	DATE

WHITSETT
6405 BURLINGTON RD
WHITSETT, NC 27377

FOUNDATION PLAN

	DATE
PERMIT	--/--/----
BID	--/--/----
CONSTRUCTION	--/--/----
RECORD	--/--/----

PROJECT MANAGER	DESIGNER
AK	MDN

JOB NO.
2020379.16

S1001